



PA-801 REV. 4

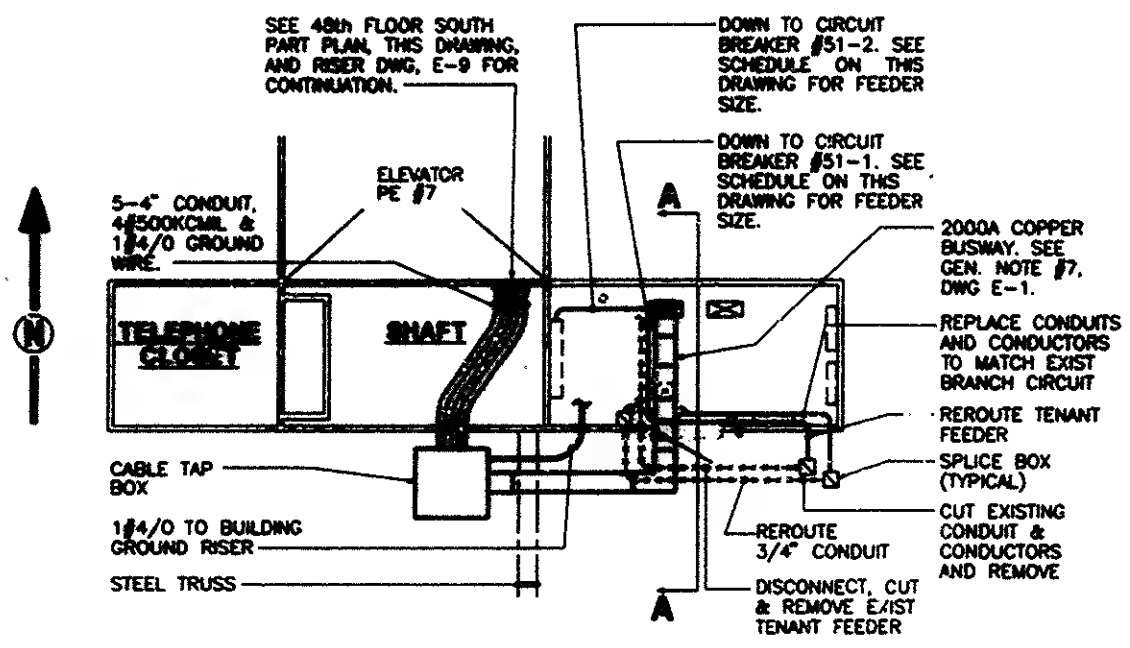


51st FLOOR SOUTH PLAN

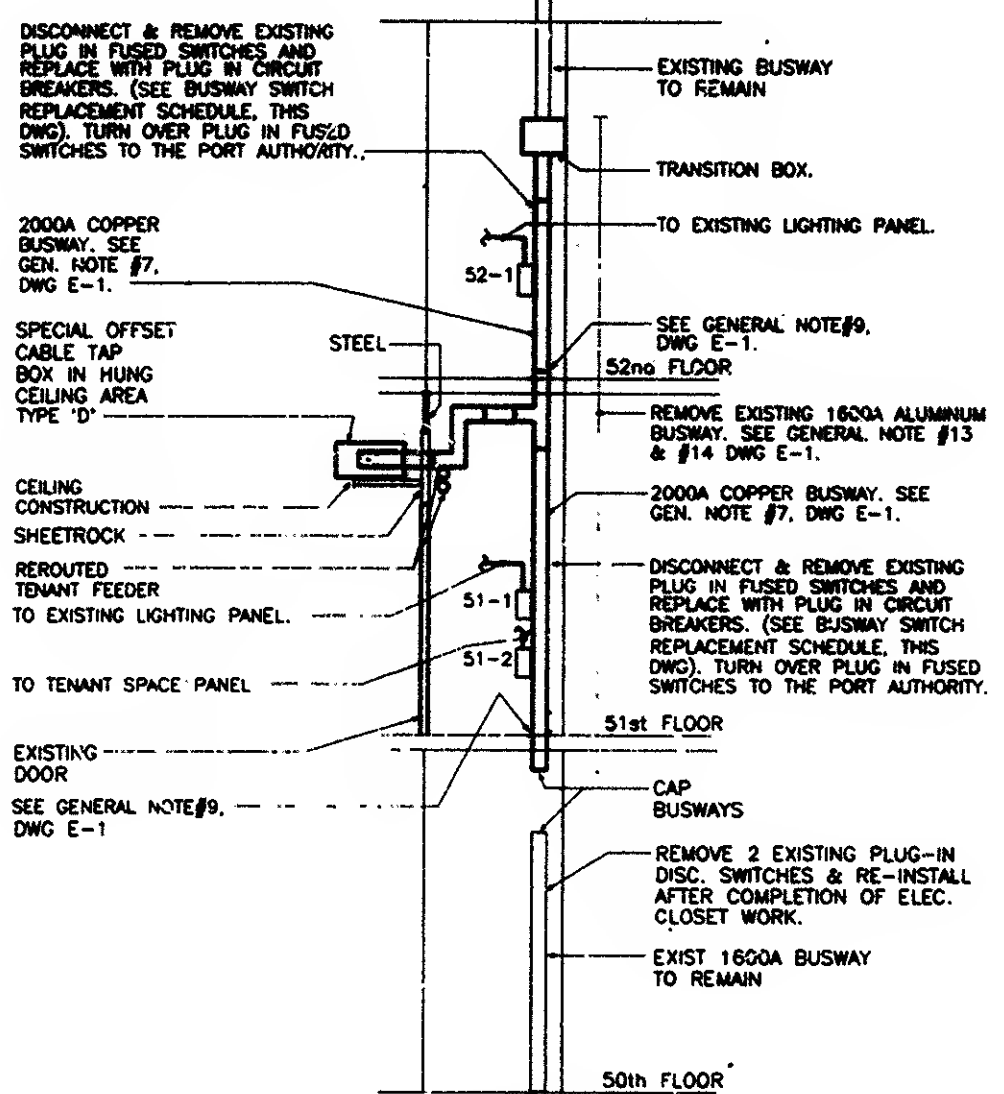


51st FLOOR SECTION A-A & PART RISER


BUSWAY SWITCH REPLACEMENT				
#	EXIST. SW. SIZE	EXIST. FUSE RATING	NEW BREAKER RATING	NEW FEEDER
52-1	200A	125A	225AF/125AT	4#1 C
52-2	200A	125A	225AF/125AT	4#1 C
51-1	200A	125A	225AF/125AT	4#1 C
32-1	200A	125A	225AF/125AT	4#1 C
32-2	200A	125A	225AF/125AT	4#1 C
32-3	200A	125A	225AF/100AT	4#1 C

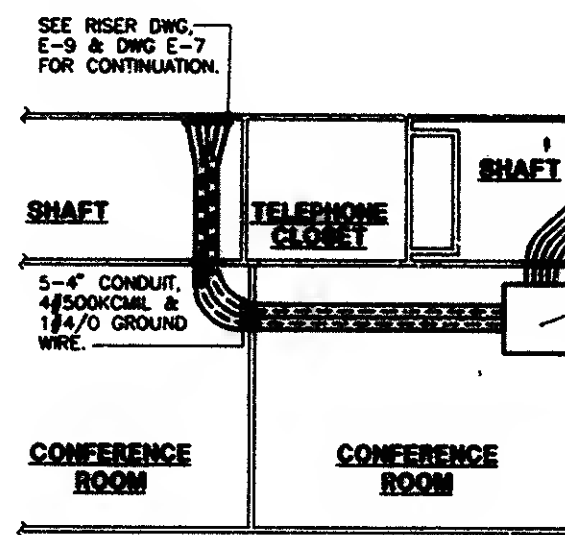


48th FLOOR SOUTH

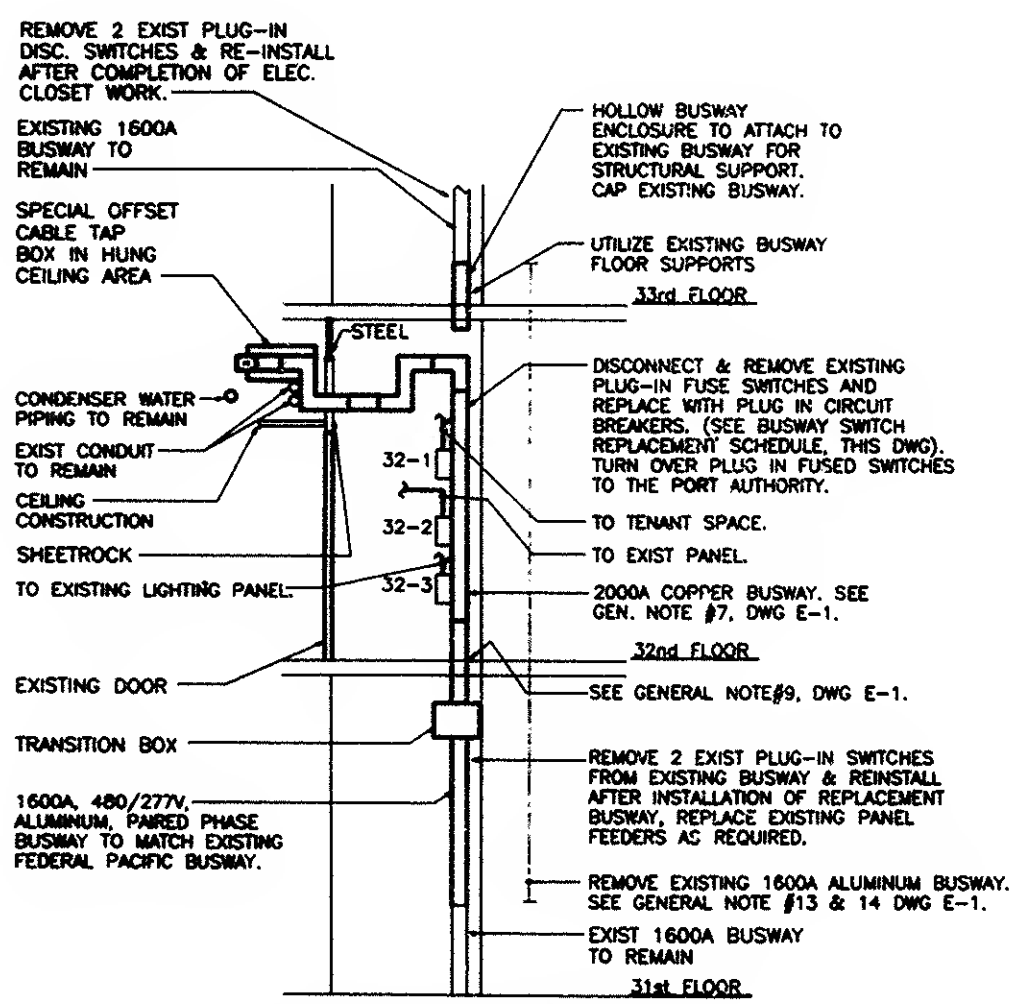

32nd FLOOR SECTION A-A & PART RISER

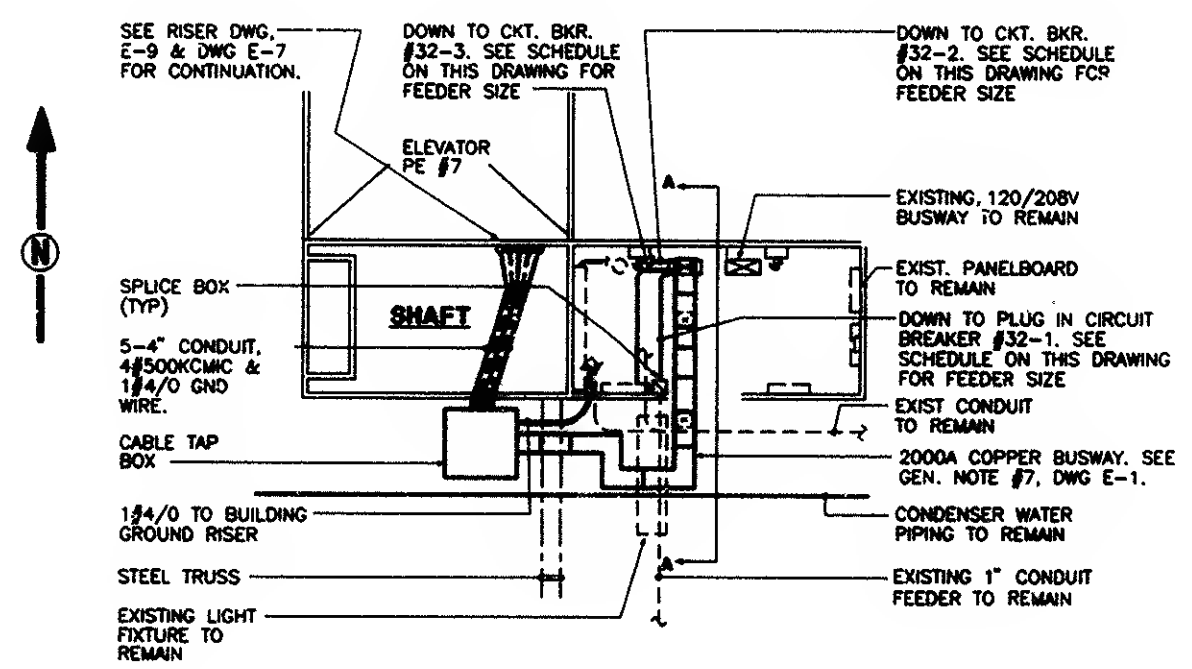

32nd FLOOR SOUTH PLAN

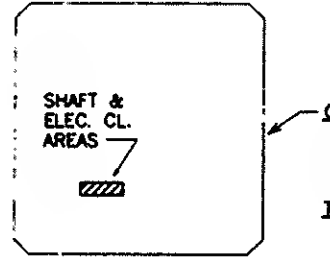

WORK AREA KEY